


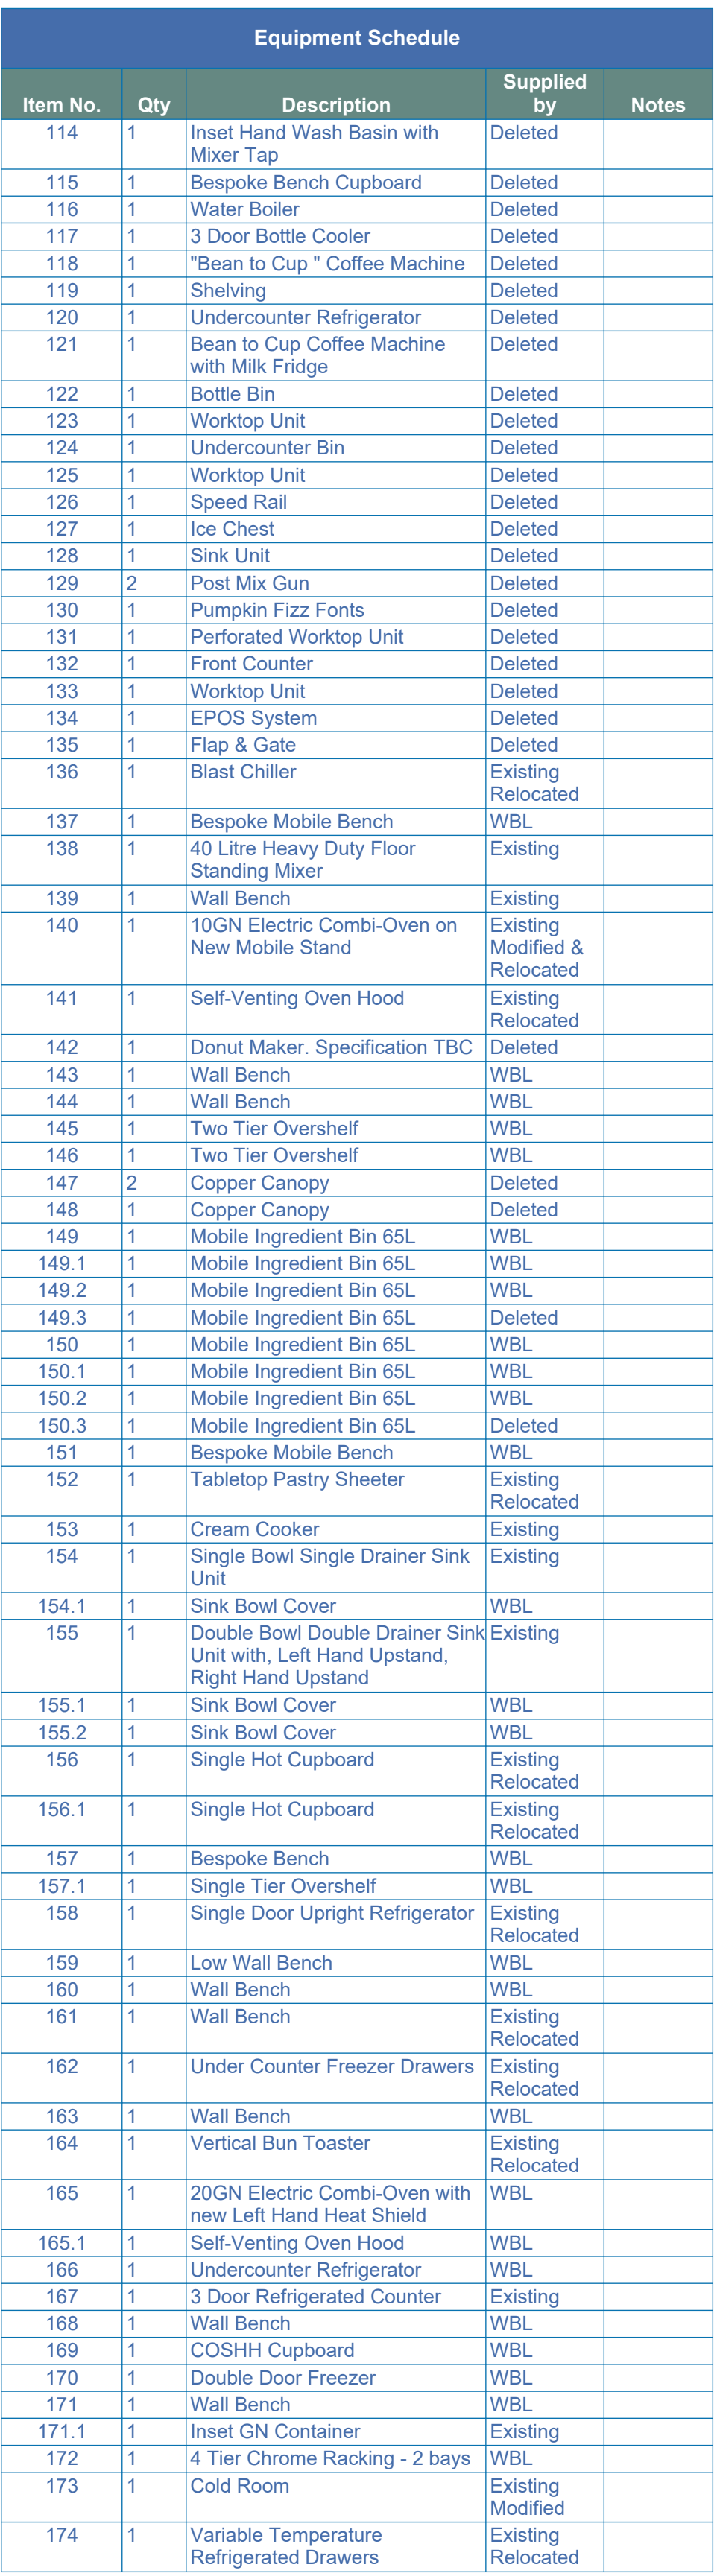

SERVICES NOTES:	SERVICES NOT SHOWN
1. ALL HOT & COLD WATER SUPPLIES TO BE TERMINATED WITH ISOLATION VALVES FACING UPWARDS	1. GENERAL LIGHTING
2. HOLD OR DISTRIBUTION TO BE 1/2" OR 3/4" W/ 1/2" W/ BLENDING VALVES TO MEET SPECIFIC WATER TEMPERATURES WHERE REQUIRED	2. GENERAL PURPOSE SOCKET OUTLETS OTHER THAN PREPARATION AREAS
3. ALL COLDER WATER SUPPLIES TO BE POTABLE	3. POSITION OF MAIN EMERGENCY SHUT-OFF SWITCHES (SUPPLIED BY OTHERS)
4. ELECTRIC SUPPLIES TO ALL REFRIGERATION EQUIPMENT TO BE ON AN INDEPENDENT CIRCUIT	4. EARTH BONDING (BY OTHERS)
5. ALL VERTICAL AND HORIZONTAL DIMENSIONS ARE TO CENTRE OF FITTINGS	5. GREASE TRAPS (BY OTHERS)
6. ANY PIPENWORK DROPS OR RUNS TO BE AGREED WITH WESTERN BLUEPRINT LIMITED AS EQUIPMENT WILL ABUT WALLS	
7. ALL WASTE PIPES TO BE TERMINATED AS SHOWN ON DRAWING - 110MM WASTE RISERS MUST NOT RISE BELOW EQUIPMENT	
8. ALL SOCKETS RATED MORE THAN 13A SPIN TO BE SUPPLIED WITH CORRESPONDING PLUG (eg. "COMMANDO" SOCKETS)	
9. MAIN CONTRACTOR TO PROVIDE SUITABLE BACKFLOW PREVENTION APPROPRIATE TO THE FLUID CATEGORY RISK AND IN ACCORDANCE WITH THE WATER REGULATIONS	
10. 13A ELECTRICAL OUTLETS RATED AT IP44 OR HIGHER TO BE "M* MASTERSEAL PLUS" OR SIMILAR IN WHITE UNLESS OTHERWISE STATED. FLUSH MOUNTED WHERE POSSIBLE	
11. ALL "13A" SOCKETS TO BE MANUFACTURED IN ACCORDANCE WITH BS 1363	
12. IF SERVICES SUPPLIED ARE NOT AS SHOWN ON THIS DRAWING WESTERN BLUEPRINT LIMITED WILL NOT BE HELD LIABLE FOR THE MALFUNCTION OF EQUIPMENT	
13. AMP SHOWS ARE CALCULATED FROM WATTS & VOLTS USING A POWER FACTOR OF 1. TOTAL LOADS DO NOT ALLOW FOR DIVERSITY.	

A	14.05.26	Drawing updated to reflect drawing no. 24250 rev G: E57 - E62 added: M16 - M19, E3, E20, & E24 - E26.1 deleted (GH)
-	-	Drawing based on drawing no. 24250-GA, Rev F - Proposed Kitchen and is subject to change following confirmation of accurate site & equipment dimensions.
REV	DATE	DESCRIPTION